
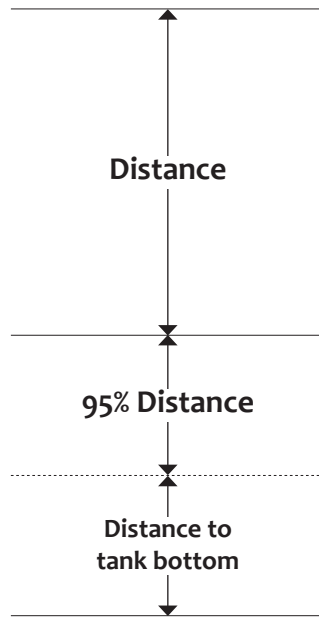


## 9095X Overfill Prevention Valve Selection Guide

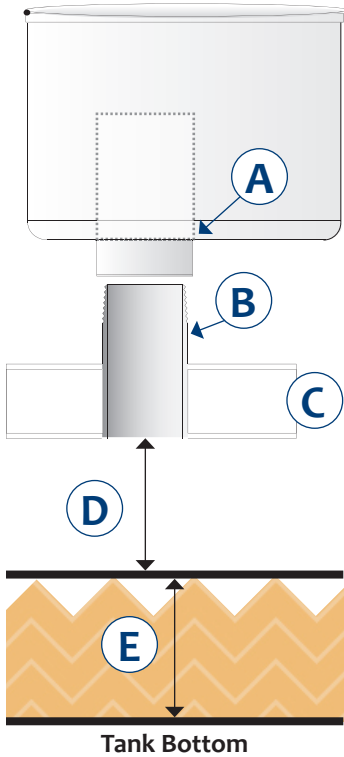

- A) Spill container height =
- +
- B) Riser height =
- +
- C) Interstitial space height =
- +

Top of primary tank

- D) 95% distance is from top of tank to desired shut-off point

Set Point Total

- E) 95% shut-off level distance to tank bottom

Tank Fit Total

Is Set Point Total within set point range?

