
## 915 TANK ALARM - QUICK REFERENCE GUIDE

## **DIP SWITCH CONFIGURATION**

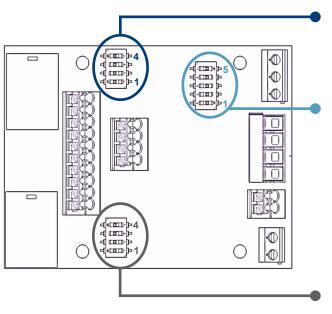

	SW3 - Output 2 Setting		
Position	ON	OFF	
4	Non-persist	Persist	
3	Normally activated (failsafe)	Normally deactivated	
2	Responds to Channel 2 input	Does NOT respond to Channel 2 input	
1	Responds to Channel 1 input	Does NOT respond to Channel 1 input	

		SW4 Setting		
<b>Position</b>		ON	OFF	
5	AUTOSILENCE	The audible alarm will automatically silence after 10 minutes of alarming.	The audible alarm will continue to sound until either the alarm condition ceases to exist, or the alarm condition has been acknowledged by pressing the Test/Silence button on the front panel.	
4	5HB	Responds to Channel 2 input	Does NOT respond to Channel 2 input	
3	915	Responds to Channel 1 input	Does NOT respond to Channel 1 input	
2	UTS	Configures input 2 for normally-closed contacts	Configures input 2 for normally-open contacts	
1	INPUT	Configures input 1 for normally-closed contacts	Configures input 1 for normally-open contacts	

	SW2 - Output 1 Setting		
Position	ON	OFF	
4	Non-persist	Persist	
3	Normally activated (failsafe)	Normally deactivated	
2	Responds to Channel 2 input	Does NOT respond to Channel 2 input	
1	Responds to Channel 1 input	Does NOT respond to Channel 1 input	

MORRISON BROS. CO.

Customer Service: (800) 553-4840 | custserv@morbros.com

## 915 TANK ALARM - QUICK REFERENCE GUIDE

## CONNECTIONS

